



Franklin Home Power User Manual

Version 1.1.03

Issued on: April 9, 2024

©2024 FranklinWH Energy Storage Inc. All rights reserved.

All information in this Manual is subject to the copyright and other intellectual property rights of FranklinWH Energy Storage Inc. This manual may not be modified, copied or reproduced, in whole or in part, without the prior written permission of FranklinWH Energy Storage Inc.

Please visit [FranklinWH Support](#) for the latest Franklin Home Power documents.

All brands and trademarks mentioned in this document are the property of their respective owners, and their use in this document does not imply the sponsorship or recognition of their products or services.

Please read this document carefully to ensure the best reliability of the product and your warranty eligibility. For further information about the warranty, please refer to the **FranklinWH Limited Warranty**.

Information or recommendations in this document constitute any express or implied warranty.



Please read this document carefully before installing or using the Franklin Home Power equipment. Failure to follow any instructions or warnings in this document may result in damage to the equipment, personal electric shock, severe injury, or even death.

Product Information

Franklin Home Power (FHP) is composed of aPower, aGate and other electrical components.

FranklinWH Energy Storage Inc. (FranklinWH) reserves the right to make any improvements to the product, and the contents in this document shall be subject to updates without further notification.

All images and pictures provided in this Manual are only for demonstration purposes and may differ in detail from the product, based on the product version.

FCC Compliance

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

MPE caution (if an FCC certified RF module is inserted in and the separation distance is indicated in the FCC grant of RF module)

To satisfy FCC / IC RF exposure requirements, a separation distance of 8in. (20 cm) or more should be maintained between the antenna of this device and persons during device operation.

To ensure compliance, operations at closer than this distance is not recommended.

Feedback

If you have any questions or comments, please send us an email at: service@franklinwh.com

Disposal of Scrapped Products

Scrapped products (including their internal chemicals and electrical materials) should not be disposed of with household wastes. Please refer to your local laws and regulations regarding disposal.



CONTENT

Safety Statements.....	1
Important Information	1
Safety Symbols	1
Safety Instructions.....	2
Warranty Statement	5
Service and Maintenance	6
Service.....	6
Maintenance	6
System Overview	7
System Design	7
System Components	9
Optional Components.....	16
Operating Modes	18
Key Functions.....	19
System Operation	25
Startup and Shutdown Steps.....	25
FHP Remote Operation and Monitoring.....	29
Common Problems and Solutions.....	30
Technical Support	32
Emergency Response.....	33





Safety Statements

Important Information

Both aGate and aPower are electrical devices. Please read this entire document to ensure the proper use of the Franklin Home Power (FHP) system. Failure to follow this may void the warranty. Please strictly follow the safety instructions in this Manual during operation, otherwise it may result in equipment malfunction, electrical shock, serious injury or death.

Safety Symbols










This Manual contains the following safety symbols, as shown below.

	DANGER: This indicates a hazardous situation which if not avoided, may result in death or serious injury.
	WARNING: This indicates a situation where failure to follow instructions may be a safety hazard or cause equipment malfunction. Use extreme caution and follow instructions.
	NOTE: This indicates information that is important for optimal system operation. Follow instructions.
	ELECTRONIC DEVICE: DO NOT THROW AWAY! All scrapped products (including their internal chemicals and electrical materials) should not be disposed of with household wastes. Please refer to your local laws and regulations regarding disposal.

* The DANGER, WARNING, and NOTE alerts are supplemental to the safety instructions and are not exhaustive.

Safety Instructions

General Information

	aGate and aPower are electrical equipment that, when used improperly, can present a risk of electrical shock and fire, and misuse may void the warranty. Only FranklinWH Certified Installers should install, maintain or replace aGate and aPower equipment or wiring. They must wear personal protective equipment (PPE) during operation.
	If the aPower battery is leaking electrolyte, smoking, or on fire, if it is safe to do so, disconnect the AC power from the FHP system and turn off the aPower switch on the side of the aPower to stop the aPower from charging and discharging.
	It is strictly forbidden to install, maintain or handle FHP equipment outdoors during bad weather such as thunder, rain, snow and high winds.
	It is strictly forbidden to work on or operate the FHP equipment alone. For safety, make sure that there is someone around you who can help.
	During use, storage, and transport, ensure that the ambient temperature of an aPower does not exceed 122 °F (50 °C), that it is not near flammables, and that the cooling system and vents are not blocked.
	During the transport and handling of aGate and aPower units, extreme care is required to avoid dropping, bumping, stomping, or inverting the equipment.
	Only use parts or accessories purchased from FranklinWH or a FranklinWH-certified party.
	Do not paint any part of an aPower or aGate unless the paint surface of the equipment housing is accidentally damaged during transport, installation or maintenance. The damaged part can be repaired with paint or topcoat of the same color.
	If any equipment failure occurs, please contact your installer or after-sales service provider for support. Do not attempt to take apart, repair and/or modify an aGate or aPower without the authorization of FranklinWH. Otherwise, it may lead to safety hazards and void your warranty.



Do not use the aPower or aGate if there is functional or cosmetic damage noticed after unboxing (except for slight paint damage). Contact after-sales service for support.



The operation of an FHP requires an internet connection. Extended offline operation may result in a voided warranty. Please refer to [FranklinWH Support](#) for information.








Add lightning protection measures to the FHP equipment according to NFPA 780, UL96A, and LPI-175.



The installation, wiring, maintenance, transportation, and handling of each aGate and aPower should follow local laws, regulations and standards, and the Safety Instructions in this Guide serve as supplementation to the laws, regulations and standards.

During the use, storage, and transport of FHP equipment:

	DANGER: Keep away from flammable and explosive materials.
	DANGER: Additional protective measures should be taken to protect equipment from access by children.
	WARNING: Keep away from dust and smoke.
	WARNING: Keep away from water sources including downspouts, sprinklers, faucets and liquid containers.
	WARNING: This product can expose you to lead, which is known to the State of California to cause cancer and birth defects or reproductive harm. (For more information go to www.p65warnings.ca.gov).

Warranty Statement

To meet warranty requirements, the FHP system must be installed and operated properly according to the instructions in related FranklinWH documents.

To secure the full 12-year warranty, the FHP system must be reliably connected to the internet to access remote services provided by FranklinWH. If an internet connection is not established or is interrupted for an extended period, and FranklinWH is unable to contact you, the warranty may be limited to less than 5 years.

Please visit us at [FranklinWH Support](#) to learn more about the warranty.

Service and Maintenance

Service

- Keep leaves and other foreign materials away from the aPower batteries. Especially keep them from the top and between the units and the back wall.
- Keep the aPower away from direct sunlight.
- Keep all FHP equipment in an environment with acceptable temperature and humidity.
- Clean the equipment surface using a soft cloth. If water is needed, please make sure the cloth is slightly damp (water only) and the equipment is completely de-energized.
- Don't block the vents.
- Keep all units away from flammable, explosive, and/or poisonous materials.
- Keep the equipment operating within the allowed power range and avoid overloading.
- Make sure all cables are wired reliably and all connectors are free of stress.
- Keep the equipment away from hazardous zones and potential risks.
- A nearby smoke detector is recommended if the equipment is installed indoors.

Maintenance

- Please check the running status of your equipment on your FranklinWH App. If any alarm is found, please contact the qualified service group.
- Please regularly check that the aPower button status is consistent with the FranklinWH App setting.
- Never attempt to repair the system by yourself. Contact the professionals qualified by FranklinWH.

System Overview

The Franklin Home Power (FHP) system is a whole home energy solution for residential users. The two key components are the aGate, an energy management unit for whole-home power control, and the aPower, an energy storage battery with a built-in inverter. Homeowners can monitor and operate their FHP systems remotely via the FranklinWH App, on iOS and Android.


System Design

The FHP system backup options include whole-home backup and partial backup. Load selection for different options must be completed during the system design phase.

Whole-home Backup


In the whole-home backup option, all household loads, except for Smart Circuit loads, are connected via the Main Panel to the backup port of the aGate. If the grid fails, the FHP system power can support all household energy loads.


FranklinWH's Solution for **Whole Home Backup**

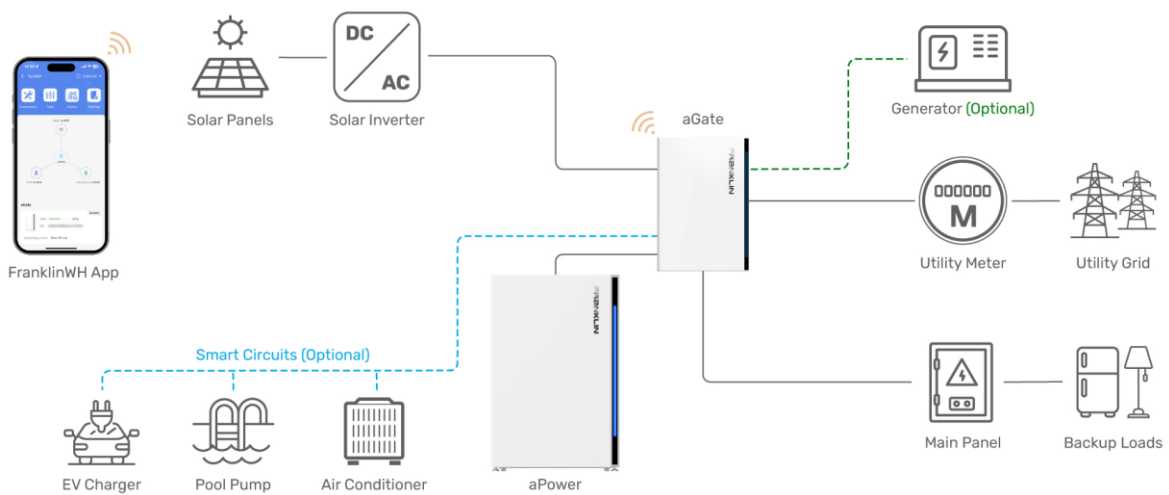

Partial Backup

If you select a partial backup configuration, you need to identify backup loads during system configuration. Connect the backup loads (except for the Smart Circuit loads) to the backup port of the aGate, and connect the non-backup loads (non-essential loads) to the non-backup ports of the aGate. If the grid fails, the FHP system will only power the backup loads during the outage.

 FranklinWH's Solution for **Partial Home Backup**

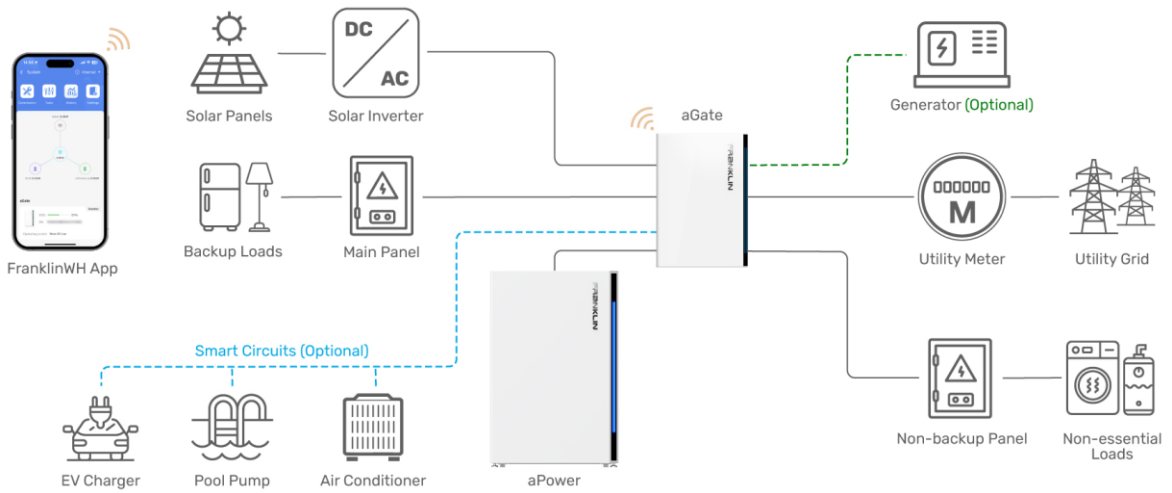


System Components

aGate

The aGate controls system operations with built-in Energy Management System (EMS), power distribution and communications modules, and optional Smart Circuits and generator modules, providing power management and backup power for household loads.

aGate external components are described below.

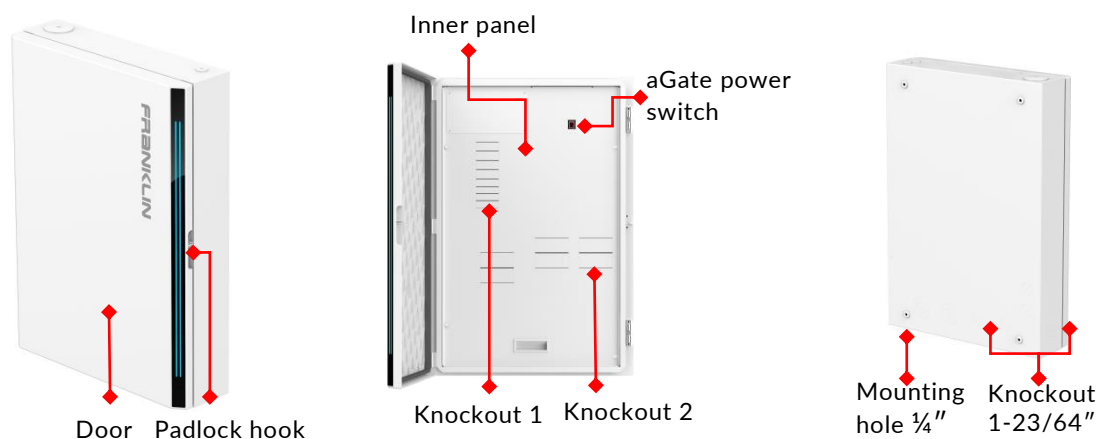

- Door: External decoration and protection panel.
- Padlock hook: The hole where a lock may be used.
- Inner panel: Internal protection panel.
- aGate power switch: aGate power switch.
- Knockout 1 and 2: After the plugs are removed, the knockouts allow for the mounting of the breakers for solar, aPower, Smart Circuits, grid, and generator.
- Mounting hole 1/4": For mounting the aGate on a wall.
- Knockout 1-23/64": A 1" electrical conduit may be passed through after the plug is removed.

Environmental Specifications	
Operation Temperature Range	-4 °F~122 °F (-20 °C~50 °C)
Storage Temperature Range	-22 °F~140 °F (-30 °C~60 °C)
Altitude maximum	
9843 feet (3000 m)	
Installation Environment	
Indoor and Outdoor Shielded	
Physical parameters	
Dimensions (W x H x D)	21.7 in. x 31.5 in. x 6.3 in. (550 mm x 800 mm x 160 mm)
Weight	50 lbs. (23 kg)

Smart Circuits Module (aGate, optional)



The aGate can use the Smart Circuits Module to provide homeowners with direct control of three unique circuits. The Smart Circuits Module is an optional component.

DANGER:




- Shutting down or disconnecting a device remotely, via the FranklinWH App, does NOT mean it has been physically powered off. Therefore, before any maintenance or connecting any new load to the system, the circuit breaker on the Smart Circuits Module needs to be physically disconnected.
- Do not touch the output ports on the Smart Circuits Module, directly or indirectly, through conductive material before disconnecting the circuit breakers.

NOTE:



If the FHP is likely to work off the grid for a long time (e.g., due to any adverse weather condition, inspection, or intentional shutting down the grid power supply when the house is idle), high-power demand devices which may automatically start should be connected to the Smart Circuits to better manage their operations and to control consumption.

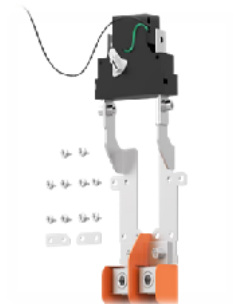Generator Module (aGate, optional)


The FHP system can connect to a household standby power generator (generator). This connection is an optional aGate component.

When the FHP is working off-grid, the generator may serve as a backup power source for the household load and to recharge the aPower. The combination of a generator and the FHP system can provide uninterrupted power to homes for a long time period, lowering the fuel consumption over time of the generator.

aPower

The aPower batteries store a charge provided by photovoltaic systems, the grid, or generators. They use an integrated inverter to convert AC power into stored DC, then convert the energy back to AC for use in a two-way energy flow. aPower batteries are modular, and can be scaled from a single battery to fifteen batteries controlled by a single aGate.

aPower external components are described below.

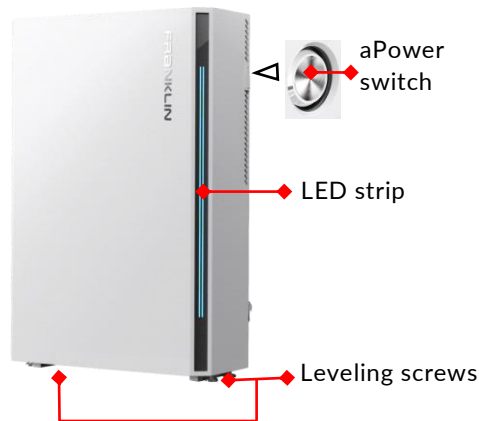

- aPower switch: Starts up or shuts off aPower power transfer.
- LED strip: Turns on when the aPower is started, indicates the battery power level.
- Leveling screws: Keeps the equipment leveled when the floor is not.





NOTE:

According to the requirements of NEC 706.15, a lockable cover needs to be added for the aPower power switch.

Users need to provide their own padlock. Please select a suitable lock based on the lock hole diameter ($d = 0.31$ in) and the available space to ensure smooth installation. If using a padlock, it needs to be opened first when installing or removing the right grille.

It is recommended for users to choose an outdoor waterproof lock and to keep the key secure.

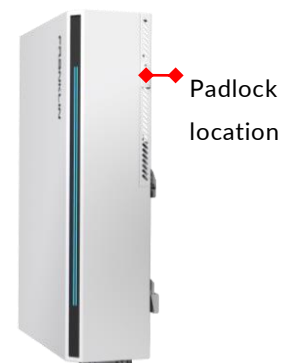

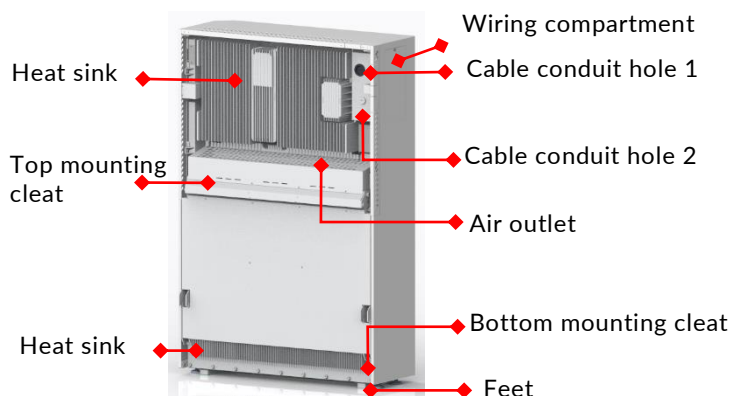


- Heat sink: Used to cool the aPower components.
- Top/Bottom mounting cleat: Must be snapped onto the mounting bracket to support the aPower body.
- Wiring compartment: The location for electric terminals and communications cable terminals.
- Cable conduit hole 1: Used to keep the power cables in position. A 1" electrical conduit may be used if the hole-plug 1 is removed.
- Cable conduit hole 2: Used to keep the signal cables in position. A ½" electrical conduit may be used if the hole-plug 2 is removed (If a signal cable hole is needed).
- Air outlet: Outlet where heat is removed, it must NOT be blocked.
- Feet: Support the aPower.


Environmental Specifications		
Operation Temperature Range		-4 °F ~ 122 °F (-20 °C ~ 50 °C)
Derated Temperature Range		113 °F ~ 122 °F (45 °C ~ 50 °C)
Recommended Temperature		32 °F ~ 86 °F (0 °C~30 °C)
Storage Duration		
Allowable Temperature Range	-22 °F~ -14 °F (-30 °C~ -10 °C) 113 °F ~ 140 °F (45°C ~60°C)	≤ 24 hours
	14 °F ~ 113 °F (-10 °C ~ 45 °C)	≤ 9 months
Installation Environment		
Indoor and Outdoor Shielded		
Altitude (maximum)		
9843 feet (3000 m)		
Physical parameters		
Dimensions (W x H x D)		29.5 in. x 45.3 in. x 11.4 in. 750 mm x 1150 mm x 290 mm)
Weight		395 lbs. (179 kg)

Optional Components

aPbox

The aPbox can be used to measure the amount of electricity generated by a PV system, and can also be used as a disconnect to sever the connection to the PV system when the photovoltaic over-generation is triggered. It supports access of up to two PV systems with a total current of no more than 65 A.

Electrical Specifications	
Nominal Voltage	120/240 VAC, split
Frequency	60 Hz
Rated Output Current	1 circuit, max 65 A
Rated Input Current	2 circuits, max 65 A total
Mechanical Specifications	
Dimensions (W x H x D)	11.8 in. x 17.7 in. x 5.9 in. (300 mm x 450 mm x 150 mm)
Weight	21.2 lbs. (9.6 kg)
Mounting Options	Wall mount (Indoors/Outdoors)
Environmental Specifications	
Operating Temperature Range	-4 °F ~ 122 °F (-20 °C ~ 50 °C)
Storage Temperature Range	-22 °F ~ 140 °F (-30 °C ~ 60 °C)
Operating Humidity (RH)	0-100 %
Maximum Altitude	9843 feet (3000 meters)
Type of Enclosure	NEMA 3R
Compliance Information	
Compliance	FCC  US

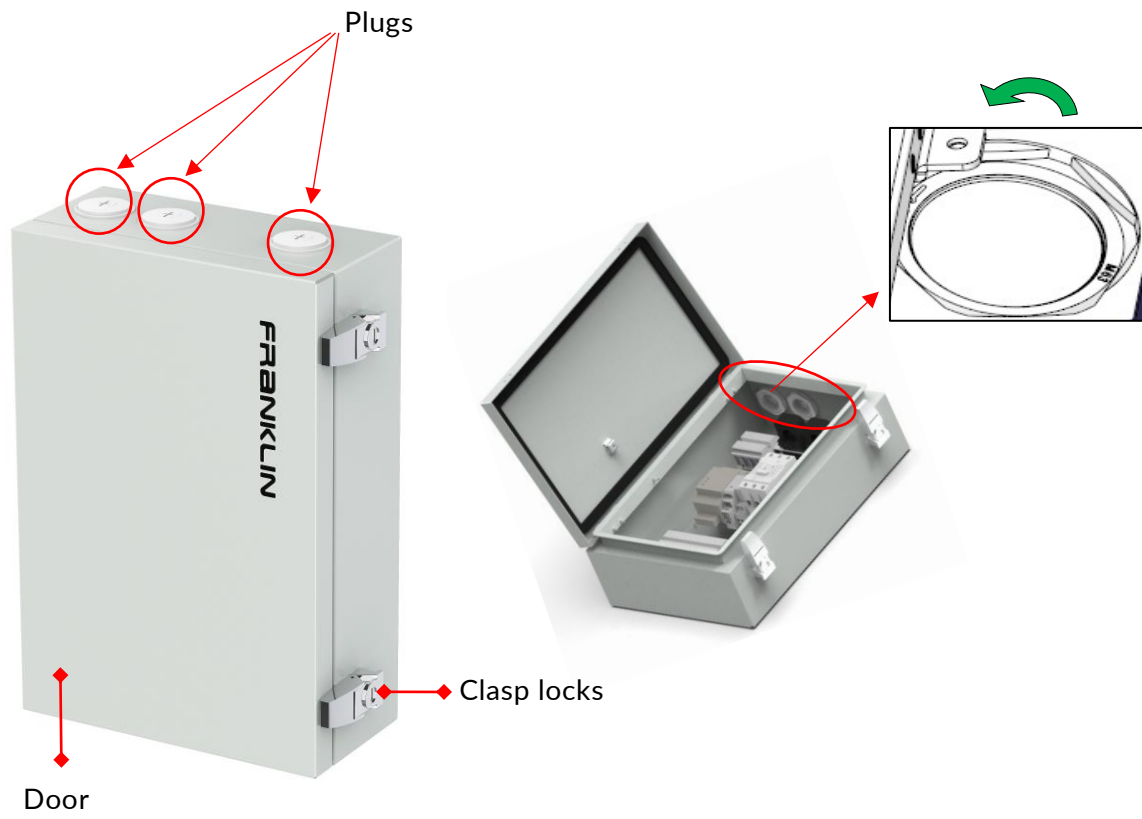

- Door: Protective cover.
- Clasp locks: To open or close the door.
- Plugs: Cable access.

Operating Modes

The FHP supports several operating modes: Emergency Backup, Self-Consumption, and Time of Use.

Emergency Backup Mode

When the FHP mode is set to the Emergency Backup, the system will prioritize charging the aPower battery to 100 % State of Charge (SOC) from solar and the utility grid.

In the event of a grid failure, the aPower battery will automatically power the household loads. As soon as the grid is restored, the system will automatically return to charging the aPower battery.

Self-Consumption Mode

When the FHP is set to the Self-Consumption, the system first provides solar (PV) power to the home loads, then stores the excess PV generated electricity in the aPower battery. If the solar production is insufficient to power all the household loads, the FHP will discharge from battery as a supportive power source, thus reducing the amount of electricity imported from the grid.

If the aPower state of charge (SOC) value for backup reserve is set 100 %, the FHP system will charge the aPower from solar and then not discharge. In the event of a grid failure, the FHP system will power the household loads.

Time of Use Mode

If the electricity rate in the homeowner's area changes throughout the day, based on demand, the homeowner can select the Time of Use mode to customize the on-peak and off-peak times according to the electricity rate. The FHP will prioritize solar and aPower battery power during peak rate periods. During the off-peak periods, the system will use power from the grid, the PV system, and the batteries in balance according to household loads.

If the SOC value for backup reserve is set 100 %, the FHP system will charge the aPower from solar and from the grid during the off-peak periods, and does not discharge. In the event of a grid failure, the FHP system will power the household loads.

Key Functions

Storm Hedge

When the Storm Hedge function is enabled, the FranklinWH App will receive a weather forecast from the National Weather Service about a potentially serious weather event, and send a warning message to the homeowner. The FHP will automatically enter emergency backup mode to power household loads during the weather event. When the extreme weather passes, the Franklin Home Power system will automatically revert to the previous settings.



NOTE

The Storm Hedge function may be enabled under both the Self-Consumption and Time of Use modes.

Emergency Stop

In an emergency, manually turn off the external Emergency Power Off (EPO) switch, if installed. Otherwise remove the EPO plug. The FHP shuts down after the EPO is triggered.



NOTE

After the emergency shutdown, the home will lose power. When the emergency issue has passed, reset the EPO switch/plug to restore home power supply.

On-grid to Off-grid

When the grid fails or is abnormal (for example, under-voltage “brownout,” overvoltage, or abnormal frequency), the FHP automatically switches to the off-grid mode. When off-grid, the solar, generator (if connected) and aPower will power the household loads.

Off-grid to On-grid

The FHP automatically switches to on-grid mode when the grid is restored and stable. The FHP will balance all energy sources power household loads.

Photovoltaic Over-Generation Protection

If the FHP is connected to the grid but is not allowed to export solar production to the grid, or when the home is off-grid, the photovoltaic over-generation protection function will be enabled when the photovoltaic output power is greater than the sum of the absorbable and load power of the FHP. The photovoltaic system will automatically be disconnected. When the photovoltaic output power is lower than the sum of the recharging power and load power of the FHP, the photovoltaic system will automatically be reconnected to the Franklin Home Power system.

Full Charge Protection

When the FHP system is off-grid, the solar system will automatically disconnect as soon as one aPower battery in the series is full (SOC = 100 %). After the FHP meets the recovery conditions, the solar system automatically connects to it and outputs power.

Black Start

When solar power is insufficient, the grid power is unavailable, and the aPower battery available power is exhausted, the Smart Circuits will be automatically disconnected and the system enters sleep mode, waiting for a black start attempt.

Automatic Black Startup

The system will automatically start at specified times every day. If the solar energy supply is sufficient, the electricity generated by the photovoltaic system will charge the aPower battery. If the solar power is insufficient, the system will re-enter sleep mode, waiting for the next automatic startup.

Manual Black Startup

When the solar energy supply is sufficient, you can manually start the system instead of waiting for the automatic black startup. Manually turn off the round button switch on the side of the aPower, turn it back on 20 seconds later, and a black start will be attempted.



NOTE:

- Repeated startup attempts may result in system lockdown. In order to increase the success rate of black startup, please make sure that the heavy electrical loads have been turned off, until the aPower is charged to 20 % SOC or higher.
 - If the grid is restored when the system is in sleep mode, the system will start immediately.
-

Smart Circuits

The FHP provides three Smart Circuits which can be controlled with the FranklinWH App based on each homeowner's personalized needs. This helps minimize household expenses while on-grid and saves battery consumption while off-grid.

On-grid

Based on local peak-valley settings and personal habits (such as pumping water into the swimming pool or charging an EV), users may set a time plan for economical power usage through the app. One or two time periods may be set for every day, to achieve the most economical use of electricity for each Smart Circuit.

Off-grid

Users may control the on/off status of Smart Circuits by creating a time plan and setting an SOC threshold. Homeowners may set an SOC threshold (between 6 % and 100 %) based on the backup sustainability of the Smart Circuits via the FranklinWH App. A lower SOC value means a longer backup period for the Smart Circuit. When the actual SOC falls below the set threshold, or the time is outside the time period set in the time plan, the Smart Circuit will be turned OFF. When the aPower SOC rises above the threshold, the aGate will reconnect the Smart Circuit.

The Smart Circuits will not be reconnected until the aPower actual SOC is 5 % higher than the SOC threshold. For example, if the SOC threshold is set to 25 %, regular backup loads will be connected when the SOC reaches 25 %, but the Smart Circuits will not be reconnected until the SOC reaches 30 %.

Manual Control

Homeowners may control the on/off status of the Smart Circuits through the FranklinWH App. The manual control of the Smart Circuits on/off status has a higher operation priority, so that the current time schedule can be overridden, disabled, and reactivated in the next time period.

The Smart Circuits Module can remotely control the on/off status of three Smart Circuits, which may be set and controlled separately. Smart Circuit 1 and Smart Circuit 2 may be set flexibly based on user needs, choosing two 1-pole breakers or one 2-pole breaker, while Smart Circuit 3 must work with one 2-pole breaker. Smart Circuit 3 is only used for 240V loads without a neutral wire. No device requiring a neutral wire should be connected to Smart Circuit 3.

Generator compatibility

The aGate connects to a generator through the optional Generator Module. Through the FranklinWH App, each homeowner can set automatic times for the generator or manual start/stop the generator as needed.

Auto Mode

In Auto Mode, generator access and disconnection can be controlled by a preset aPower SOC or can be scheduled by setting up the time periods for generator runs.

SOC Control

The generator will be activated automatically when the FHP is working in off-grid mode and after battery SOC falls below the set level (20 % default. Adjustable between 10 % and 80 %). The system will activate the generator to power the load, with the surplus power generated sent to charge the aPower.

When there is power supply from the grid or the FHP system battery level reaches the upper SOC (80 % default, adjustable 20-100 %), the generator will be automatically shut off and other sources will power the loads.

Charging Schedule

Based on their own habits, users may set up a charging schedule through the app for the time periods when power supply from the grid is interrupted. The settings allow up to three non-overlapping time periods in a single calendar day. Once the charging schedule is enabled, when the generator is activated to power the loads, it also charges the aPower. When the charging periods ends, the generator will be shut off.

Manual Mode

When the power supply from the grid is interrupted, users may manually start/shutdown the generator. For example, when a power outage occurs, the user may start the generator manually before leaving, to charge the aPower batteries in advance, and may shut off the generator via the app before they return home, so that the FHP will take over as the power source. This helps to manage the noise produced by the generator, so that customers may enjoy a quieter home environment.

aPbox Application

While the aGate has a PV breaker as an optional component, there are some situations in which the PV system cannot be connected through the breaker or where there are multiple PV connections needed. In those instances, an aPbox can be used to connect the solar source to the aGate or the grid.

There are two scenarios that define how the external connections with an aPbox are connected.

PV on the load side of the FHP

Installation of an aPbox is required to meter the production of and cutoff the connection to an individual PV system installed on the load side of the FHP system due to:

- Existing constraints, such as the location of the PV system and the aGate, preventing the PV system connection to the aGate internal PV interface.
- Multiple PV systems on-site preventing a distinct PV system from being connected to the aGate.
- The total PV system output power exceeding the power rating of the aGate internal PV interface.
- The total amount of the PV production exceeds the aPower energy capacity.

One aGate supports up to two aPbox connections on the load side. The FHP system controls the PV system connection according to whether the photovoltaic over-generation in the off-grid mode.

PV on the line side of the FHP

The installation of an aPbox is to monitor the generation of the PV system and provide data to the FHP system.

In this scenario, one aGate only supports one aPbox connection.

**NOTE:**

When there is a grid outage, the line side separated PV system will disconnect from the grid and shut down.

Heating film functionality

The FHP can operate normally in low temperatures with built-in heating film in the aPower battery pack.

How to maintain normal battery performances in low-temperatures?

There are 16 temperature sensors employed in the Franklin battery pack to monitor the temperature of each battery cell in real time, while a heating film is attached to each battery surface. The aGate decides whether to turn on the heating film function when the battery temperature is lower than the starting threshold, depending on the battery capacity as well as charge/discharge requirements. The heating film function will be turned off once the battery temperature reaches the set value. Thus, the battery can operate normally within the specified temperature range.

How does heating film function in low-temperatures?

There are 4 pieces of heating film attached in the battery pack, each of which is rated at 100 W, powered by the DC side of the battery. The heating film starts heating the battery when the battery temperature is below 42.8 °F until the battery temperature rises to 50 °F, then turns to keep-warm mode, maintaining the battery temperature within 42.8 °F ~ 50 °F. The power consumption of the heating film is directly related to ambient temperature i.e., the colder the environment, the faster the battery dissipates heat, resulting in longer heating time and more power loss.

What impact will the low temperatures bring?

The battery Round Trip Efficiency (RTE) becomes lower as the battery available capacity is reduced in low temperatures due to the natural chemical characteristics of lithium-ion batteries, as well as the power loss caused by the heating film. When the ambient temperature drops too low, such as -20 °C, the heating function of the battery may fail to maintain the required operation temperatures, resulting in battery shutdown or failure.



NOTE:


Heating film operation may cause 500W power consumption per aPower.

System Operation

The Franklin Home Power system can be operated locally or remotely, but local operation is preferred for maintenance and inspection. It is recommended that the FHP be restarted and maintained locally. During maintenance or inspection, local operation must be used to ensure circuit safety.

Startup and Shutdown Steps


Switch/breakers on aGate

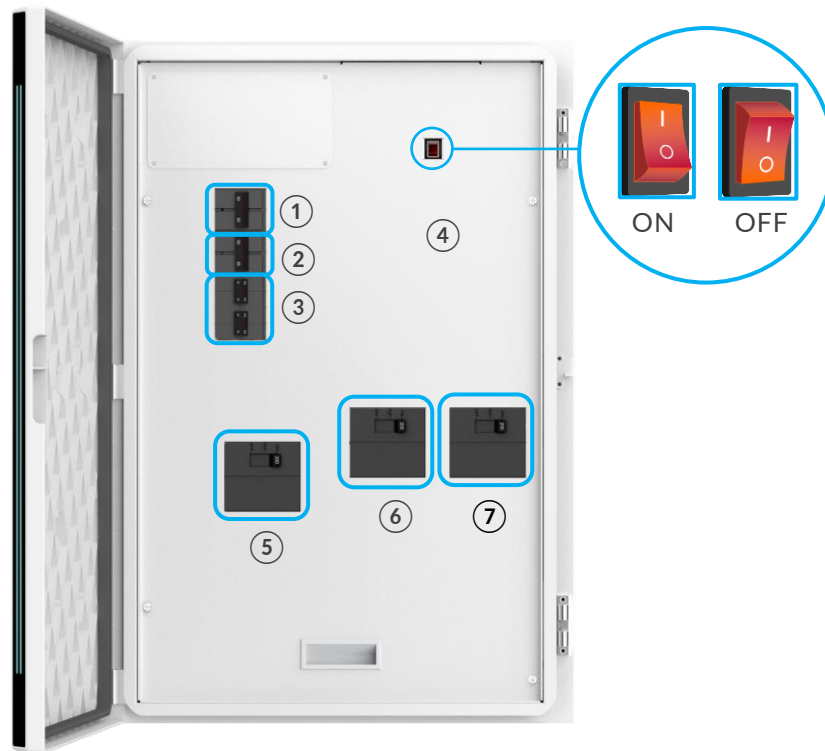

- ① Solar Breaker
- ② aPower Breaker
- ③ Smart Circuit Breakers
- ④ aGate Power Switch
- ⑤ Backup Breaker
- ⑥ Grid Breaker
- ⑦ Generator Breaker

***Note:** The circuit breaker are optional parts and must be provided by the installer.

The aPower power switch and LED strip

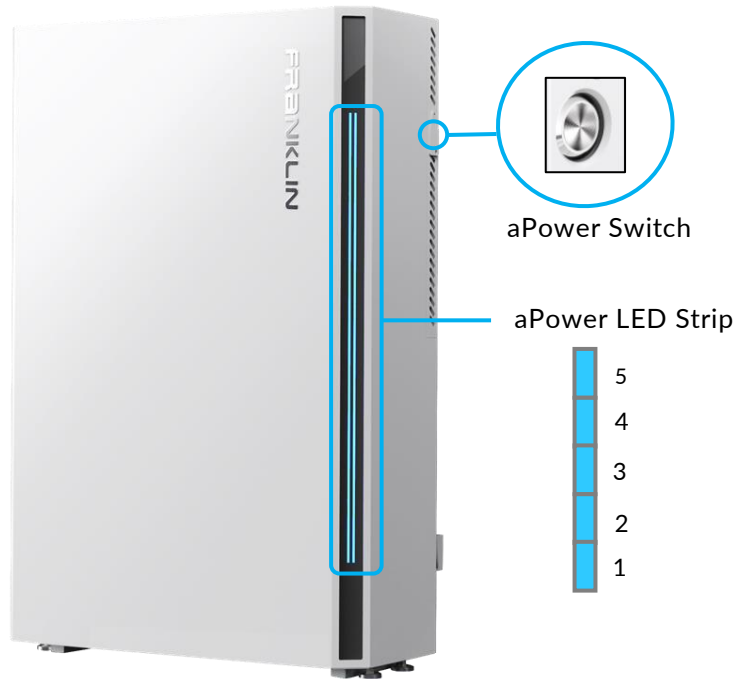

aPower LED Strip lighting descriptions

LED state

- █ OFF
- █ Solid
- █ Pulsing
- █ Flash

Pulsing: 10 second cycle from off, brightening to fully lit.
 Flash: Alternating ON/OFF, once per second for aPower X failure, ON for 400ms and OFF for 2100ms during discharging, standby and on-grid shut-down.

Booting

After the aPower X is powered on for five seconds, the five strips flash every second. After one minute, the aPower X is initialized and enters the standby mode.

aPower X failure

All five strips flash synchronously once per second, indicating an aPower X failure.

Off-grid shut-down

When the aPower X is turned off while disconnected from the grid, all five strips will go out.


Charging

SOC < 20%	20% ≤ SOC < 40%	40% ≤ SOC < 60%
60% ≤ SOC < 80%	80% ≤ SOC < 100%	SOC = 100%

Discharging/Standby/On-grid shut-down

SOC ≤ 5%	5% < SOC < 20%	20% ≤ SOC < 40%
40% ≤ SOC < 60%	60% ≤ SOC < 80%	80% ≤ SOC ≤ 100%

Startup Steps

1. Ensure that the grid breaker, the generator breaker, the backup breaker, and the solar breaker are all in the OFF position (for initial use).
2. Ensure that the aGate power switch on aGate is in the ON position.
3. Turn on the aPower breaker.
4. Press the aPower switch to ensure that the switch is on. When the aGate power switch indicator on the aGate lights up, wait until the bottom of the LED strip on the aPower lights up, which indicates that the aGate is successfully powered without connecting to the grid.
5. After about 60 seconds, the photovoltaic relay turns on automatically. If the aPower has power output, that indicates that the aPower has successfully started without connecting to the grid.
6. If the grid is normal, turn on the aGate grid breaker. After the grid relay is turned on, the grid icon on the FranklinWH App  homeowner home screen will light up, indicating that the aPower is successfully connected to the grid.
7. Turn the generator breaker (if the Generator Module is installed) and solar breaker to the ON position.
8. Turn on the Smart Circuit breakers (if the Smart Circuits Module is installed), the backup breaker and the breakers in the load panel.

**NOTE:**

The initial startup process includes steps 1 to 8, while the general restart process is as follows: turn off the aGate power switch and the aPower switch, wait for 5 seconds after the LED strip on the aPower go out, then turn on the aGate power switch, and follow the instructions in steps 3 to 8.

Shutdown Steps

1. Turn off the grid breaker if connected to the grid.
 2. Press the aPower switch on all aPower batteries to the OFF position (extended, flush with the case), and each LED strip will go out.
 3. Turn off the aPower breaker.
 4. Turn off the solar breaker.
 5. Turn off the generator breaker if connected to a generator.
 6. Turn off the Smart Circuits and backup breakers if applicable.
 7. Turn off the aGate power switch inside the aGate.
-




NOTE:

If the family plans to be gone for a long time, please keep the grid or solar power, aPower breaker, aPower switch and aGate power switch on. Otherwise, the energy stored in aPower will eventually be depleted, resulting in a startup failure.

FHP Remote Operation and Monitoring

The FranklinWH App provides monitoring and remote operation of the FHP at anytime from anywhere. It allows personalized household electricity plans to make your life easier.

The home screen of the FranklinWH App displays real-time data from the FHP to help you understand the working status of your home power system. Please refer to the **FranklinWH App User Manual** for more information.

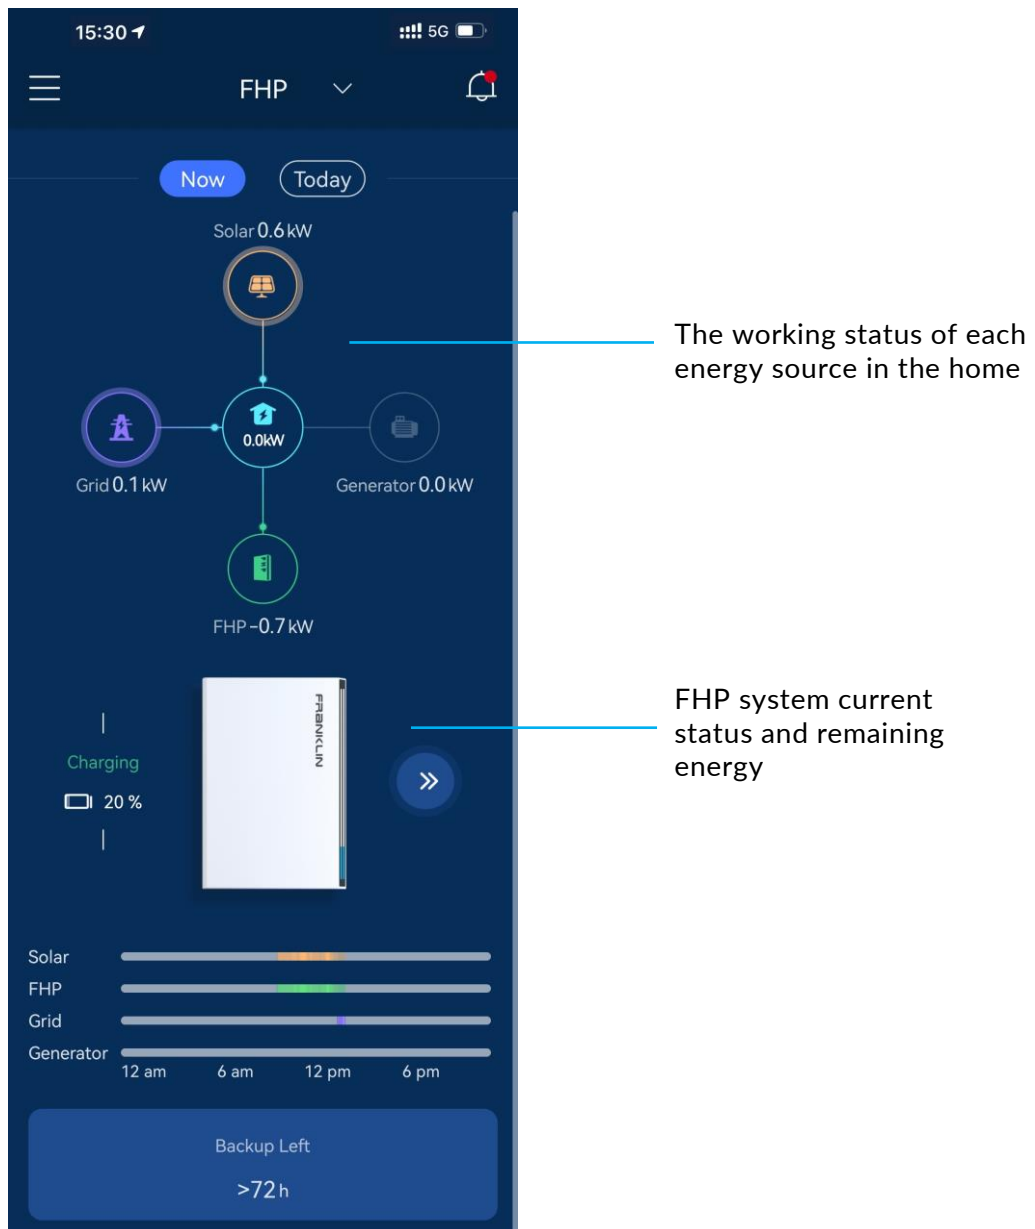

**Note: If the generator is disabled, the generator icon will not appear.*

Common Problems and Solutions

No.	Problems	Solutions
1	aPower LED on the aPower keeps flashing once per second.	<p>Check if the aGate EMS module is working normally:</p> <ol style="list-style-type: none"> Check that the aGate power switch is ON (closed) and the indicator is lit. Check if the aGate is connected to an external EPO (Emergency Power Off) switch. If yes, check that the EPO switch is closed. Check that the aPower breaker on the aGate is in the ON position.
2	aPower starts off-grid and fails to discharge.	Check whether the aPower breaker on the aGate is in the ON position. If not, flip it on and then check the aPower status after 1 minute. If aPower discharges properly, the equipment is back to normal.
3	The aGate failed to activate the Wifi access point.	Turn off the aGate power switch and turn it on after 30 seconds. Scan for network broadcast by the aGate on your mobile phone. If your mobile phone is connected to it, the Wifi access point has returned to normal.
4	"Device offline" is displayed on the app.	<p>Check whether the aGate communication network is normal:</p> <ol style="list-style-type: none"> If the aGate is communicating via hard-wired ethernet, please check the network connectivity. If the aGate is communicating via Wifi, check the signal strength. If a 4G cellular network is used, please check the network conditions at the aGate location. If the signal strength is poor, contact your installer to purchase a 4G cellular network enhancement option.
5	A prompt of "Low battery, black start attempts" is displayed on the app.	<p>Check whether the grid power is down and whether the solar system is out of operation or there is insufficient sunlight.</p> <ol style="list-style-type: none"> Low battery and black start indicate that the battery capacity is very low, the backup power and auxiliary power will be disconnected, and the system will enter sleep mode. Once the system enters sleep mode, it will automatically recover and charge the batteries the next day if there is sufficient sunlight. By default, the system black start times are approximate 10:00, 12:00 and 14:00. There may be some deviations in time in sleep mode. During black start, please turn off all household loads to ensure that Franklin Home Power system can be started normally. Manual black start is also an alternative to automatic. Manual Start: Turn off the aPower switch on the side of aPower (extended, flush with case), and turn it back on (depressed) 20 seconds later. The system will start up. Black start will consume the reserve capacity, it is recommended to attempt a manual start only when there is enough solar production. Otherwise, the system may lock.
6	A prompt message of "Black start failed" is	<ol style="list-style-type: none"> Check if there are household electrical devices running when the system attempts to start. Ensure that all the household electrical devices are shut down, to help the system successfully start.


No.	Problems	Solutions
	displayed on the mobile app.	ii. Check whether the solar system is operating normally and whether there is sufficient sunlight.
7	"Off-grid overload" is displayed on the app.	i. Check if the grid is available. ii. Check if there are large electrical devices running. If yes, shut down the unessential devices to allow the system to operate normally. iii. Due to the special characteristics of the battery, the system power is slightly reduced at temperatures below 50 °F (10 °C) to guarantee the service life of the battery. If an off-grid overload occurs in this case, shut down the large electrical devices to allow the system to operate normally. iv. If the system experienced an off-grid overload during multiple aPower units starting, turn off all electrical devices and turn them back on in sequence after the aPower units have been successfully started.
8	The system shuts down after an air conditioner or a pump is started.	i. Check if the grid is available. ii. During a grid outage, due to the power required to start the air conditioner or pump, the system may shut down while other large electrical devices are running when trying to start the air conditioner or pump. Because of this, it is recommended that you shut off other large electrical devices and restart them after the air conditioner or pump has been successfully started.

Technical Support


For further support, please contact the installer or FranklinWH service team at: [FranklinWH Support](#). Please be prepared to provide the following information before you contact FranklinWH:

- Owner name
- Your preferred desired contact method (name, phone number, email)
- The serial number of your aGate and aPower (as shown in the figure below)
- A brief description of your problem

aGate serial number

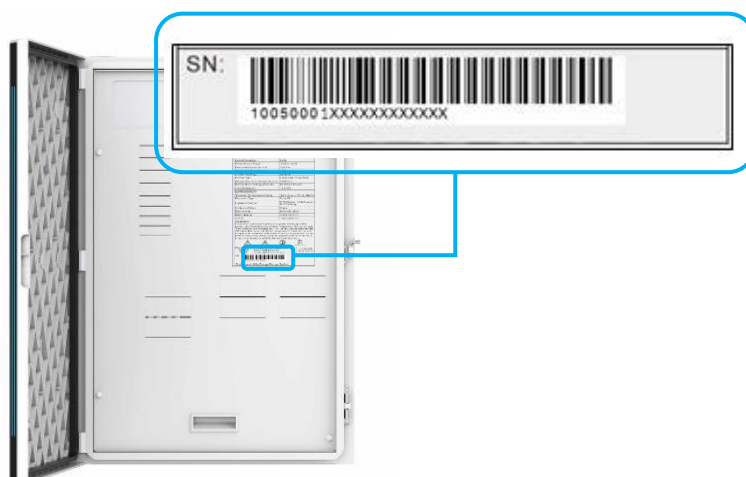

aPower serial number

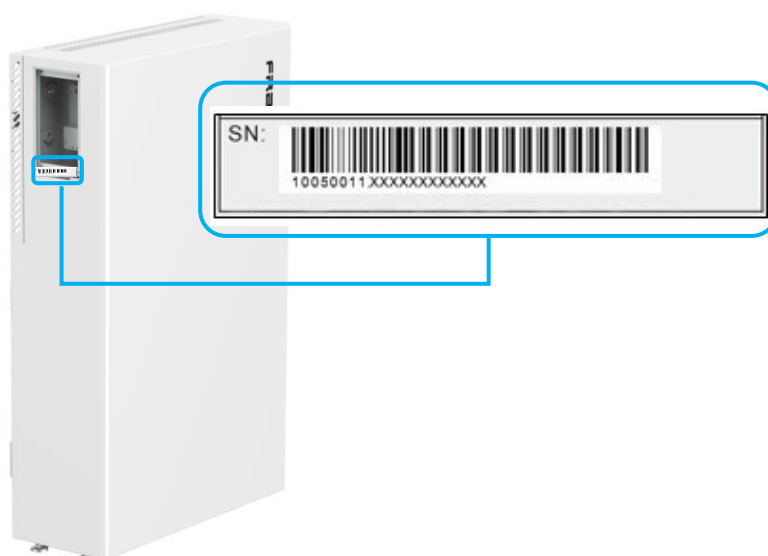

Emergency Response

In any hazardous situation that may damage health and cause serious injury, follow the recommended actions:

- Evacuate to safe area.
- Contact the 911 as soon as it is safe to do so.

In case of fire

- Shut off the aPower breaker on the aGate, when it is safe to do so.
- Evacuate to safe area.
- Contact the 911 as soon as it is safe to do so.
- Use approved fire extinguishing devices, if it is safe to do so.

In case of flooding

- If the wiring sections of an aGate or aPower is submerged, please keep away from the water. It is an electrocution hazard.
- Drain the water to protect your FHP equipment, if it is safe and possible.
- If water reaches the battery, please call your installers for inspection. If the water level is below the battery, please completely dry the site and your FHP equipment before use.

In case of abnormal noise, odor or smoke

- Check to ensure the air vent of the aPower is not blocked.
- Keep the installation site well ventilated.
- Call your installer for support.